



ELEVATION

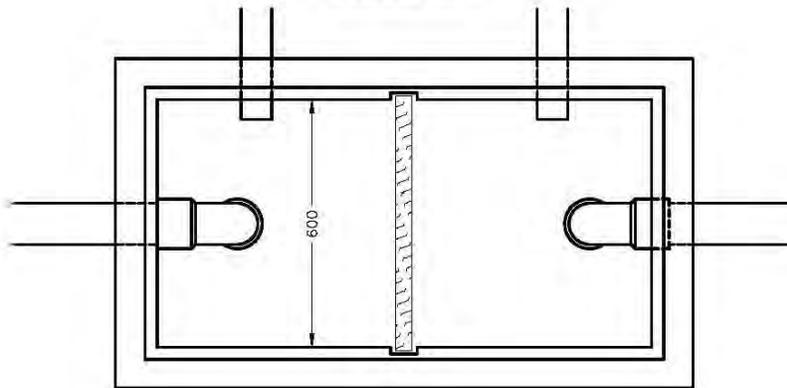

PLAN

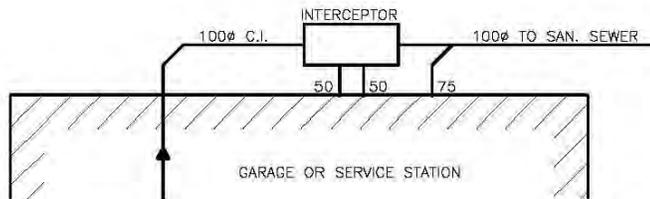

- MIN. 75mm VENT REQUIRED ON THE INTERCEPTOR WASTE OUTLET.
- INTERCEPTOR TO BE LOCATED OUTSIDE AND ADJACENT TO THE BUILDING.
- SERVICE BAY FLOOR DRAINS OR TRENCH DRAINS ARE NOT TO BE TRAPPED.
- VENT PIPES TO EXTEND AT LEAST 3.048m ABOVE THE SURROUNDING GROUND.
- INCREASE THE INTERCEPTOR 150mm IN LENGTH FOR EACH SERVICE BAY OVER THREE IN NUMBER.
- 50mm LOCAL VENT HEIGHTS ARE TO BE STAGGERED, ONE 300mm ABOVE THE OTHER TO PROMOTE A CIRCULATION OF AIR WITHIN THE INTERCEPTOR.

NOTE:
ALL DIMENSIONS SHOWN IN mm
UNLESS OTHERWISE NOTED.

				THE CORPORATION OF DELTA ENGINEERING DEPARTMENT			DSN.	DRN. M.M.	DWG. No.
							CHKD.	APVRD.	L 1775B
OIL, GAS OR GREASE INTERCEPTOR FOR PUBLIC GARAGES (TYPE 2)				SCALE	N.T.S.	DATE	2014-03-13	RVSN.	
				DATE	REVISION	No.	BY		
REVISIONS									